


VII A


# 2024-25 San Luis Storage Projection 90% Exceedance Hydrology

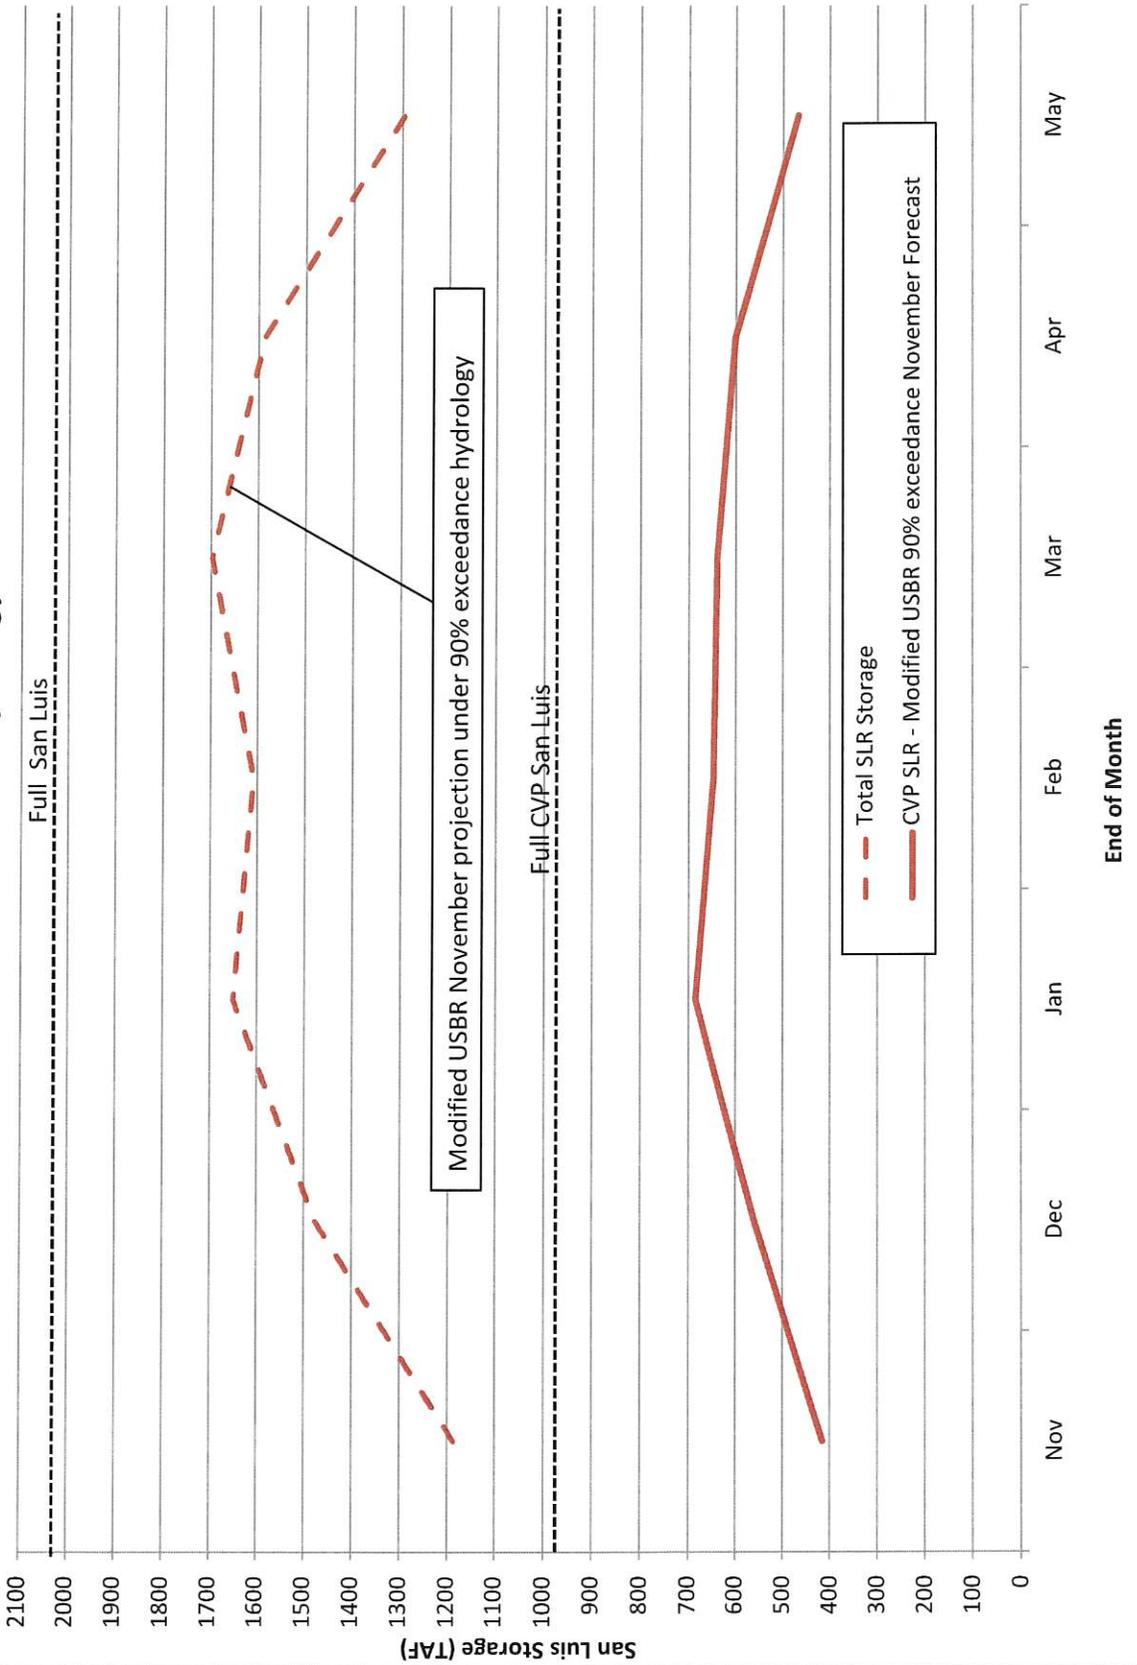

Modified USBR November projection under 90% exceedance hydrology

20

# 2024-25 San Luis Storage Projection 50% Exceedance Hydrology

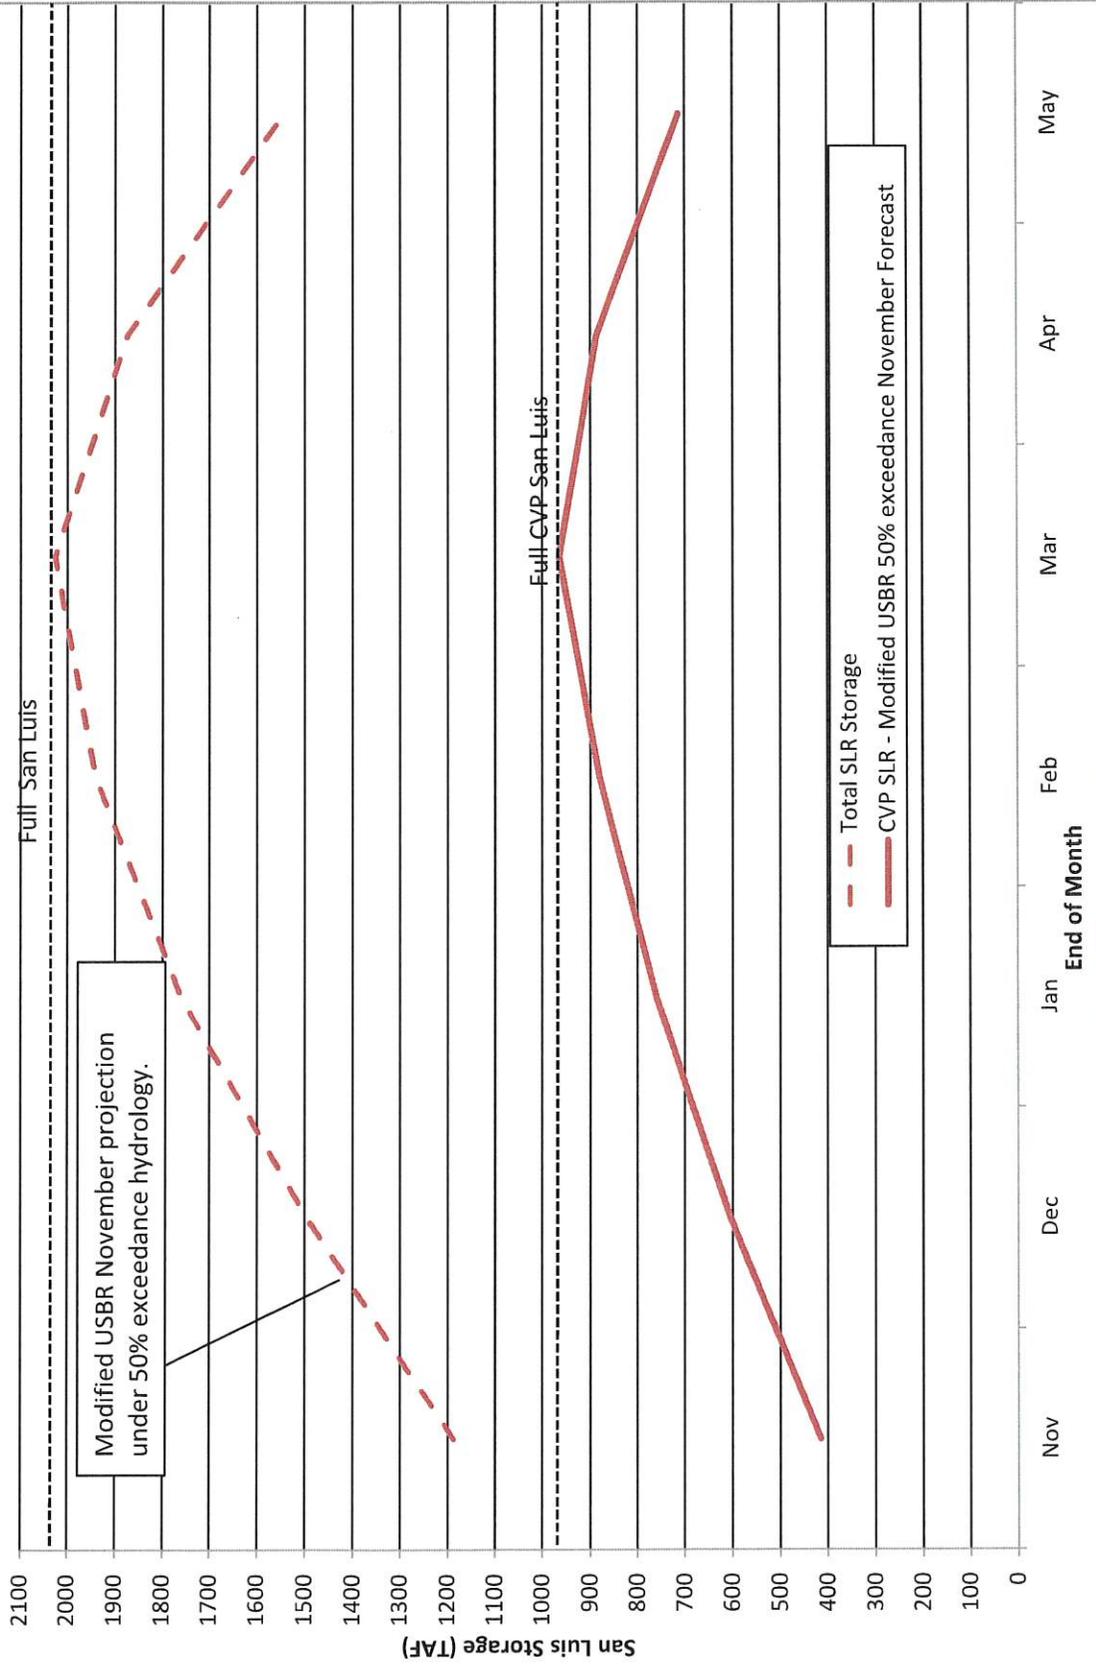

201

VII B

**DEL PUERTO WATER DISTRICT 2024-25 SUPPLY/USE/COMPLETED TRANSACTIONS SUMMARY  
as of November 30, 2024**

Supply Type	2024-25
2023-24 Rescheduled NVRWP Supply	8,694
2023-24 Rescheduled CVP Supply	14,021
Less: Monthly 1% Storage Loss Est.	(274)
Sub-Total: Rescheduled Supplies	22,441
2024 CVP Allocation (60%)	70,105
2024 NVRWP	18,256
Sub-Total: Current Year Customer Supplies	88,361
2024 GWD Transfer	124
2020 Lower Tule River I.D. (Rtn)	452
2015 City of Huron Exchange (Rtn)	100
2024 SLCC Pump-In Exchange	171
Subtotal: Outside Purchases	847
<b>Total Gross Projected Supply Available</b>	<b>111,649</b>

November 2024 Quantity	Completed to Date
------------------------	-------------------

0	17676
---	-------

7	49
0	452
0	100
0	171

2023-24 IN DISTRICT USE		2024-25 IN DISTRICT USE	2024-25 OCRRP USE	2024-25 TRANSFERS OUT	2024-25 MONTHLY USE
135	MAR	2,281		4,474	6,755
4,057	APR	4,039	55	290	4,384
7,900	MAY	12,161		3,028	15,189
11,855	JUN	14,294		4,581	18,875
14,380	JUL	14,683		1,258	15,941
11,283	AUG	9,196		63	9,259
6,662	SEP	6,820		548	7,368
4,429	OCT	4,970		22	4,992
1,518	NOV	1,343			1,343
930	DEC				0
18	JAN				0
151	FEB				0
63,318		69,787	55	14,264	
<b>TOTAL USED &amp; TRANSFERRED OUT</b>					<b>84,106</b>
<b>TOTAL SCHEDULED</b>					<b>3,100</b>
<b>TOTAL ESTIMATED FOR RESCHEDULING INTO 2025-26</b>					<b>24,443</b>
<b>TOTAL GROSS PROJECTED SUPPLY AVAILABLE</b>					<b>111,649</b>

Stored Supplies: 3,209 AF - AEWSO 2020, 1,500 AF - LTRID 2020, 4,934 AF - AEWSO 2023, 1,445 AF - OCRRP 2023, 49 AF - OCRRP 2024.

602

*Blank*

VII B

**Adam Scheuber**

---

**From:** Ben Koehler <bkoehler@modestogov.com>  
**Sent:** Tuesday, December 10, 2024 11:45 AM  
**To:** Paul Stearns; John Klarich, III  
**Cc:** Gus Giron; Adam Scheuber; Anthea Hansen  
**Subject:** RE: Tertiary Plant Update

I'll let John confirm, but the current schedule is that the contractor will be finished between 12/16 and 12/18. As soon as we can bring the plant back up, we'll want to take a Coliform test to confirm the system is working properly. Then we will resume discharge.

Ben Koehler  
WQC Superintendent – Chief Plant Operator  
City of Modesto – Wastewater Division  
C: (209) 652-7782  
O: (209) 342-4502

**From:** Paul Stearns <pstearns@delpuertowd.org>  
**Sent:** Tuesday, December 10, 2024 11:25 AM  
**To:** John Klarich, III <jklarich@modestogov.com>  
**Cc:** Ben Koehler <bkoehler@modestogov.com>; Gus Giron <ggiron@modestogov.com>; Adam Scheuber <ascheuber@delpuertowd.org>; Anthea Hansen <ahansen@delpuertowd.org>  
**Subject:** RE: Tertiary Plant Update

Good Morning John,

Are you still anticipating returning to full/normal flow to the DMC on or around 12/15?

Thanks,

Paul

**From:** John Klarich, III <jklarich@modestogov.com>  
**Sent:** Tuesday, November 19, 2024 9:56 AM  
**To:** Paul Stearns <pstearns@delpuertowd.org>; Adam Scheuber <ascheuber@delpuertowd.org>; Anthea Hansen <ahansen@delpuertowd.org>  
**Cc:** Ben Koehler <bkoehler@modestogov.com>; Gus Giron <ggiron@modestogov.com>  
**Subject:** RE: Tertiary Plant Update

Good morning ,

There was 0 flow from 11-8-2024 thru 11-11-2024 due to the pipeline leak and repair

**From:** John Klarich, III  
**Sent:** Tuesday, November 19, 2024 6:46 AM  
**To:** Paul Stearns <pstearns@delpuertowd.org>; Adam Scheuber <ascheuber@delpuertowd.org>; Anthea Hansen <ahansen@delpuertowd.org>

63

**Cc:** Ben Koehler <[bkoehler@modestogov.com](mailto:bkoehler@modestogov.com)>; Gus Giron <[ggiron@modestogov.com](mailto:ggiron@modestogov.com)>  
**Subject:** RE: Tertiary Plant Update

I will find out and let you know.

**From:** Paul Stearns <[pstearns@delpuertowd.org](mailto:pstearns@delpuertowd.org)>  
**Sent:** Friday, November 15, 2024 8:32 AM  
**To:** John Klarich, III <[jklarich@modestogov.com](mailto:jklarich@modestogov.com)>; Adam Scheuber <[ascheuber@delpuertowd.org](mailto:ascheuber@delpuertowd.org)>; Anthea Hansen <[ahansen@delpuertowd.org](mailto:ahansen@delpuertowd.org)>  
**Cc:** Ben Koehler <[bkoehler@modestogov.com](mailto:bkoehler@modestogov.com)>; Gus Giron <[ggiron@modestogov.com](mailto:ggiron@modestogov.com)>  
**Subject:** RE: Tertiary Plant Update

**External Email:** Please use caution when clicking links and/or opening attachments.

Good Morning John,

Thank you for the update. Could you provide a list of days and times that flow to the DMC was stopped?

Thanks,

Paul

***Paul Stearns***

Deputy General Manager - Water Operations  
Del Puerto Water District  
17840 Ward Avenue  
P.O Box 1596 (for U.S. Mail)  
Patterson, CA 95363-1596  
Ph: (209)892-4470  
Fax: (209)892-4469  
Cell: (209)620-5377



**From:** John Klarich, III <[jklarich@modestogov.com](mailto:jklarich@modestogov.com)>  
**Sent:** Thursday, November 14, 2024 9:30 AM  
**To:** Adam Scheuber <[ascheuber@delpuertowd.org](mailto:ascheuber@delpuertowd.org)>; Paul Stearns <[pstearns@delpuertowd.org](mailto:pstearns@delpuertowd.org)>; Anthea Hansen <[ahansen@delpuertowd.org](mailto:ahansen@delpuertowd.org)>  
**Cc:** Ben Koehler <[bkoehler@modestogov.com](mailto:bkoehler@modestogov.com)>; Gus Giron <[ggiron@modestogov.com](mailto:ggiron@modestogov.com)>  
**Subject:** Tertiary Plant Update

Good morning ,

Here is a plant update , we have been experiencing some planned and unplanned downtime the past few weeks and currently with both Tertiary Plants due to Transmittance issues that we are hoping to resolve with a current study. We also are currently lining and coating our 12.6 MGD facility U.V. channels for better performance which

64

will cause some more downtime starting next week. This should be completed by mid-December ; I apologize for any inconvenience this may cause. Please let me know if you have any questions or concerns .

**Thank you,**

**John Klarich III  
Utilities Plant Operations Supervisor / Jennings Facility  
City of Modesto Wastewater Division**

**Office-209-342-4512  
Per.Cell-209-380-9145  
Work Cell-209-596-2405**

*Blank*

VII C

# 2024-25 Annual Additional Supplies Pool

12.16.24

YEAR 2024-25	250	300	100	452	1102
	District Bank	GWD L2 Exch	City of Huron	LTRID Return	Misc
SLDMWA					2024 Rev
BOR Rate					2024 COS
Other					2023 loss
To Seller	\$62.00	\$25.00	\$25.00	\$25.00	\$1,419,800.00
Est Cost	<u>250</u>	\$400.00	\$150.00	\$101.31	\$397,996.32
	\$15,500.00	\$425.00	\$175.00	\$126.31	\$1,019,342.84
		<u>300</u>	<u>100</u>	<u>452</u>	\$1,619.00
		\$127,500.00	\$17,500.00	\$57,092.12	\$17,008.04
					\$6,744.16
					\$89,439.00
					1,102
					<b>\$329,941.48</b>
					<b>\$299.40</b>

64

Blank



Vll, C

11/25/2024

David E. Hyatt  
Resource Management Division Chief  
South Central California Area Office  
Bureau of Reclamation

Transmitted via email

Subject: Yuba Water Transfer Warren Act Contract

Dear Mr. Hyatt:

The San-Luis & Delta-Mendota Water Authority is requesting to enter into a Letter of Agreement (LOA) to provide funding for the preparation of environmental documentation necessary to execute a long-term Warren Act Contract to convey Yuba Transfer by the beginning of 2026. Per the below details, we are requesting that the environmental documentation and related Warren Act Contract cover 2026-2050. If this process cannot be completed in time to convey Yuba Transfer water by 2026, we would like to work with Reclamation to explore short-term options to allow the conveyance of Yuba Transfer water until the long-term Warren Act Contract can be executed. The below information was emailed to your office on October 28, 2024:

### Information For Yuba Water Transfer Extension Warren Act Contracts

**San Luis & Delta-Mendota Water Authority: October 26, 2024**

**1. Volumes to be transferred:**

Based on the current Lower Yuba River Accord (Yuba Accord) program and Supplemental EIR for the Extension of the Yuba Accord Long-Term Water Transfer Program includes storage surface water transfers of up to 200,000 acre-feet per year with up to 100 TAF allocated to SLDMWA, and groundwater substitution water transfers of up to 90,000 acre-feet per year and up to 180,000 acre-feet in a three-year period with 45,000 acre-feet per year allocated to the SLDMWA.

15990 KELSO ROAD

**2. Participating member agencies:**

Participants	
Byron-Bethany Irrigation District	Panoche Water District
Broadview Water District (can be combined with Westlands Water District)	San Benito County Water District
Del Puerto Water District	San Luis Water District
Eagle Field Water District	Santa Clara County Water District
Mercy Springs Water District	Westlands Water District
Pacheco Water District	

BYRON, CA

94514

209 832-6200

**3. Duration of the Warren Act Contract coverage** we are seeking to match the duration of the Yuba Accord Water Transfer extension, which is through 2050.

209 833-1034 FAX

le7

4. SLDMWA Participant's Yuba Water Allocations

	Total AF	Yuba Allocation %	Initial Gap Warren Act Contract Allocation of Yuba Surface and Ground water Substitution Water-SLDMWA Share (AF)	Long Term Warren Act Contract - Allocation of Surface and Groundwater Substitution Water -SLDMWA Share (AF)	Total
			80,000	145,000	225,000
BBID	20,600	1.2421%	994	1,801	2,795
BWD	27,000	1.6280%	1,302	2,361	3,663
DPWD	140,210	8.4540%	6,763	12,258	19,021
EFWD	4,550	0.2743%	219	398	617
Mercy Springs	2,842	0.1714%	137	248	386
Pacheco	10,080	0.6078%	486	881	1,367
Panoche	94,000	5.6677%	4,534	8,218	12,752
SBCWD	35,550	2.1435%	1,715	3,108	4,823
SLWD	120,631	7.2735%	5,819	10,547	16,365
SCVWD	34,665	2.0901%	1,672	3,031	4,703
WWD	1,168,383	70.4477%	56,358	102,149	158,507
Total	1,658,511	100.00%	80,000	145,000	225,000

5. CVP Facilities Needed to Convey Yuba Water Transfer

- Jones Pumping Plant
- Delta-Mendota Canal
- Delta-Mendota Canal/California Aquaduct Intertie
- O'Neill Pump/Generation Plant
- San Luis Reservoir
- Gianelli P/G Plant
- San Luis Canal
- Pacheco Pumping Plant/Tunnel-San Felipe Division

Please let me know if you need any additional information to establish the LOA. We look forward to hearing back from you at your earliest convenience.

Sincerely,

*Pablo Arroyave*

Pablo R. Arroyave  
 Chief Operating Officer  
 San Luis & Delta-Mendota Water Authority

68

VIID

**Del Puerto Water District**  
Active Permits and Licenses  
As of November 30, 2024

**Active Permits**

<u>Permit No.</u>	<u>Issued Date</u>	<u>Expires</u>	<u>Project</u>	<u>Landowner/Entity</u>	<u>Location</u>
P2502004	4/23/2024	4/22/2025	Temporary Pipeline on DMC Right-of-Way	Yamamoto	28.19L
P2502006	4/29/2024	4/29/2025	Monthly Water Samples for Trihalomethanes (THM's)	City of Turlock/NVRRWP	37.24 to 45.77
P2502015	7/2/2024	11/30/2024	PG&E to reestablish electrical service	Amaravati	56.85L
P2502018	8/12/2024	8/12/2025	Drafting of Water for Landfill Dust Control	Stan. Co./Fink Road Landfill	45.77R/Davis Rd.
P2502021	11/13/2024	12/1/2024	Remove, Repair, and Replace Pump and Motor	JEM Ranches	61.37R

**Active Licenses**

<u>Permit No.</u>	<u>Issued Date</u>	<u>Expires</u>	<u>Project</u>	<u>Landowner/Entity</u>	<u>Location</u>
23-LC-20-3085	9/11/2023	9/11/2048	Orestimba Creek Recharge and Recovery Project	CCID/DPWD	51.65L/O-Creek

609

Blank

VII E.

**Anthea Hansen**

---

**From:** Vignau, Melissa <mvignau@usbr.gov>  
**Sent:** Friday, December 13, 2024 2:20 PM  
**To:** Anthea Hansen; Frances Mizuno  
**Cc:** Emerson, Rain L  
**Subject:** RE: [EXTERNAL] RE: Triangle T Transfer Discussion Meeting

Good Afternoon Anthea!

Your timing is impeccable. I just ran across this email yesterday and reached out to the team to ensure they are spending time to review this EA. I have not heard back from CVO regarding my inquiries to them on this effort. I will be reconvening with the team late January and can follow up with you after that time.

Thank you,  
Melissa

**From:** Anthea Hansen <ahansen@delpuertowd.org>  
**Sent:** Friday, December 13, 2024 11:34 AM  
**To:** Vignau, Melissa <mvignau@usbr.gov>; Frances Mizuno <mizunoconsulting@gmail.com>  
**Cc:** Emerson, Rain L <remerson@usbr.gov>  
**Subject:** RE: [EXTERNAL] RE: Triangle T Transfer Discussion Meeting

Hi Melissa,

I hope all is well! I know when I sent the email below I received an "out of office" message. I was just circling back to inquire if you have had a chance to review our draft and if we can schedule a follow up discussion with your team.

Sincerely,  
Anthea

*Anthea G. Hansen*  
General Manager  
Del Puerto Water District  
PH 209-892-4470/FAX 209-892-4469

**From:** Anthea Hansen  
**Sent:** Tuesday, November 26, 2024 11:42 AM  
**To:** Vignau, Melissa <mvignau@usbr.gov>; Frances Mizuno <mizunoconsulting@gmail.com>  
**Cc:** Emerson, Rain L <remerson@usbr.gov>  
**Subject:** RE: [EXTERNAL] RE: Triangle T Transfer Discussion Meeting

Good morning, Melissa and Rain,

70

Thank you for your recent note regarding having not forgotten about this transfer. Attached is the Draft EA as promised in our last call. After your team has had a chance to review, We would love to have another discussion. I am fairly available the week of December 9<sup>th</sup>.

Happy Thanksgiving, All!

Sincerely,  
Anthea

*Anthea G. Hansen*  
General Manager  
Del Puerto Water District  
PH 209-892-4470/FAX 209-892-4469

**From:** Vignau, Melissa <[mvignau@usbr.gov](mailto:mvignau@usbr.gov)>  
**Sent:** Thursday, October 10, 2024 1:57 PM  
**To:** Anthea Hansen <[ahansen@delpuertowd.org](mailto:ahansen@delpuertowd.org)>; Frances Mizuno <[mizunoconsulting@gmail.com](mailto:mizunoconsulting@gmail.com)>  
**Cc:** Emerson, Rain L <[remerson@usbr.gov](mailto:remerson@usbr.gov)>  
**Subject:** RE: [EXTERNAL] RE: Triangle T Transfer Discussion Meeting

Hey Anthea,

Great news! DWR will be available to participate at tomorrow's meeting.

The items below have been shared with you before and still require a path forward to consider your proposal. Triangle T Water District is a non-CVP contractor, therefore, Sections 3405(a)(1)(A), Historic Use, and 3405(a)(1)(I), Consumptive Use, of the CVPIA apply and require compliance with State Water Law and Transfer Guidelines.

-3405(a)(1)(A). No transfer or combination of transfers...shall exceed, in any year, the average annual quantity of water under contract delivered to the contracting district or agency during the last three years of normal water delivery prior to the date of enactment of this title.

- What was Del Puerto's average annual quantity of water under contract delivered during the last three years of normal water delivery prior to enactment of the CVPIA? Was it more or less than the 9,000 af proposed for transfer to Triangle T Water District?

-3405(a)(1)(I). The water subject to transfer shall be limited to water that would have been consumptively used or irretrievably lost to beneficial use during the year of the transfer.

- What action is Del Puerto WD taking to make the CVP water available for transfer? Consistent with the Draft Technical Information for Preparing Water Transfer Proposals (December 2019) and Section 3405(a)(1)(I) of the CVPIA, Del Puerto WD must take an action to make Central Valley Project Water available for transfer.

Looking forward to the call tomorrow.  
Thanks, Melissa